


PLAN VIEW

1. Concrete strength to be 4,500 psi after 28 days
2. V-1403 Ring & cover - EJIW or approved equal
3. Top section shall be designed to support cast iron frames and cover
4. Joints between the precast units shall be sealed with flexible watertight rubber gaskets

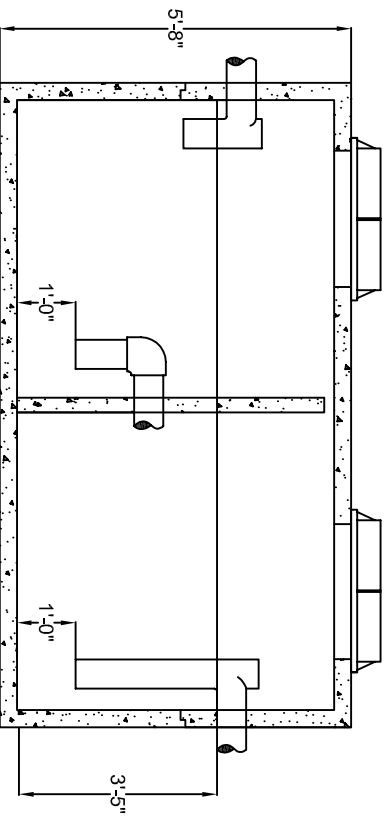

SIDE VIEW

GREASE TRAP

1,500 GALLONS

WASTEWATER TREATMENT OF LOUISIANA, INC.

1629 S. PARK, GONZALES, LA. 70737
PH 504-673-3156

by: THOMAS F. PERTUIT, P.E.