
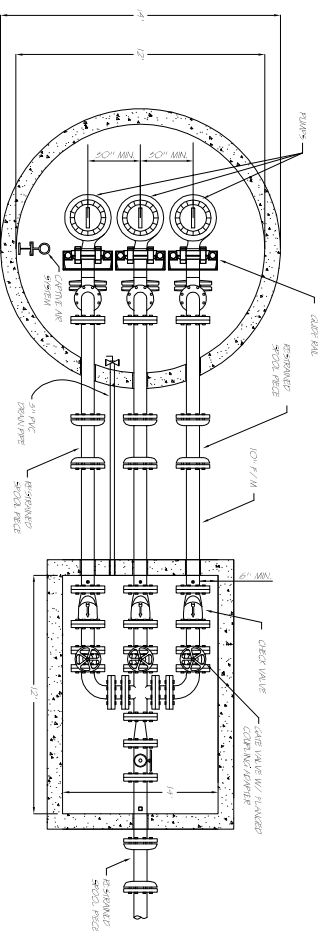


ELEVATION VIEW

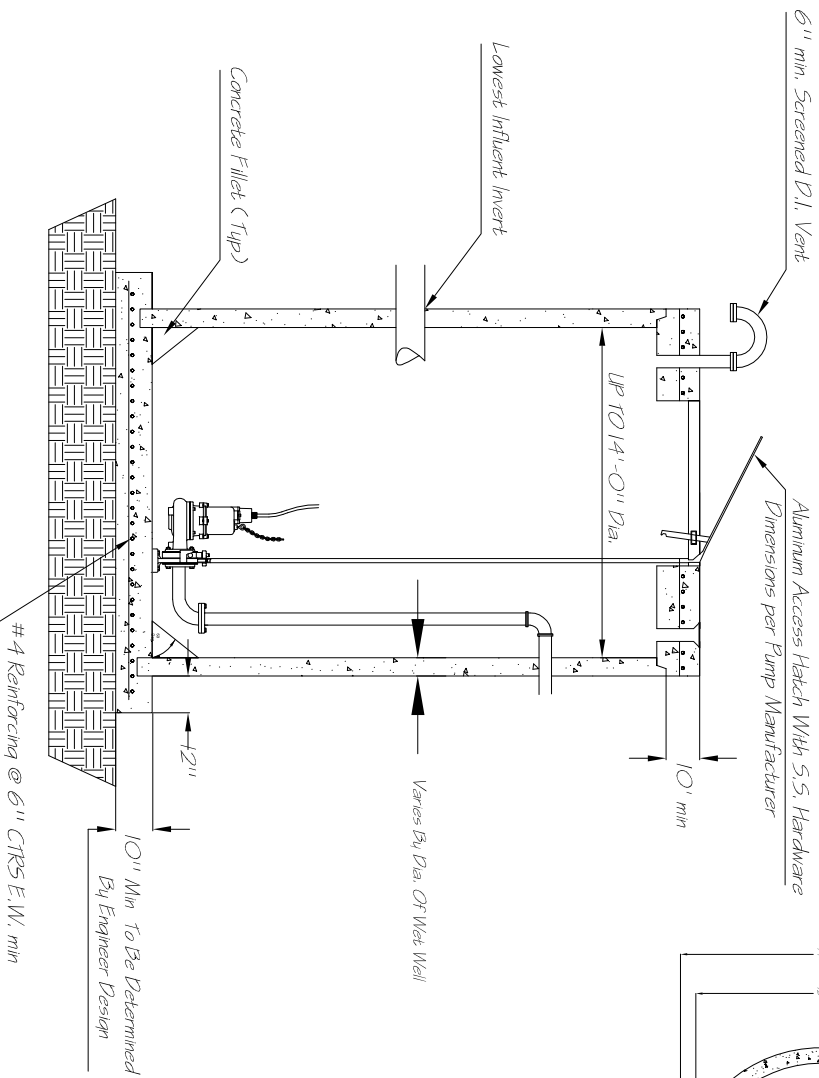

PLAN VIEW

1. Precast concrete sections shall be cured by an approved method and shall achieve a minimum compressive strength of 5,000 psi at the end of 28 days. Type II cement shall be used.
2. Precast concrete sections shall be manufactured in accordance with the provisions of ASTM C478 as modified herein.
3. The top slab and subsurface structures shall be manufactured in accordance with Section 805-14
4. All interior and exterior concrete surfaces shall be coated in accordance with Section 822.
5. Joints between the precast units shall be sealed in accordance with Section 803-2

WASTEWATER TREATMENT OF LOUISIANA, INC.

171088 Airline Hwy, Ste M-157
 Prairieville, LA 70769

by:
 THOMAS F. PERTUIT, P.E.

TRIPLEX PUMP STATION TYP.

UP TO 14' INSIDE DIAMETER